


# AC 12/2021



## ORAS BERBESTI SAT DAMTENI

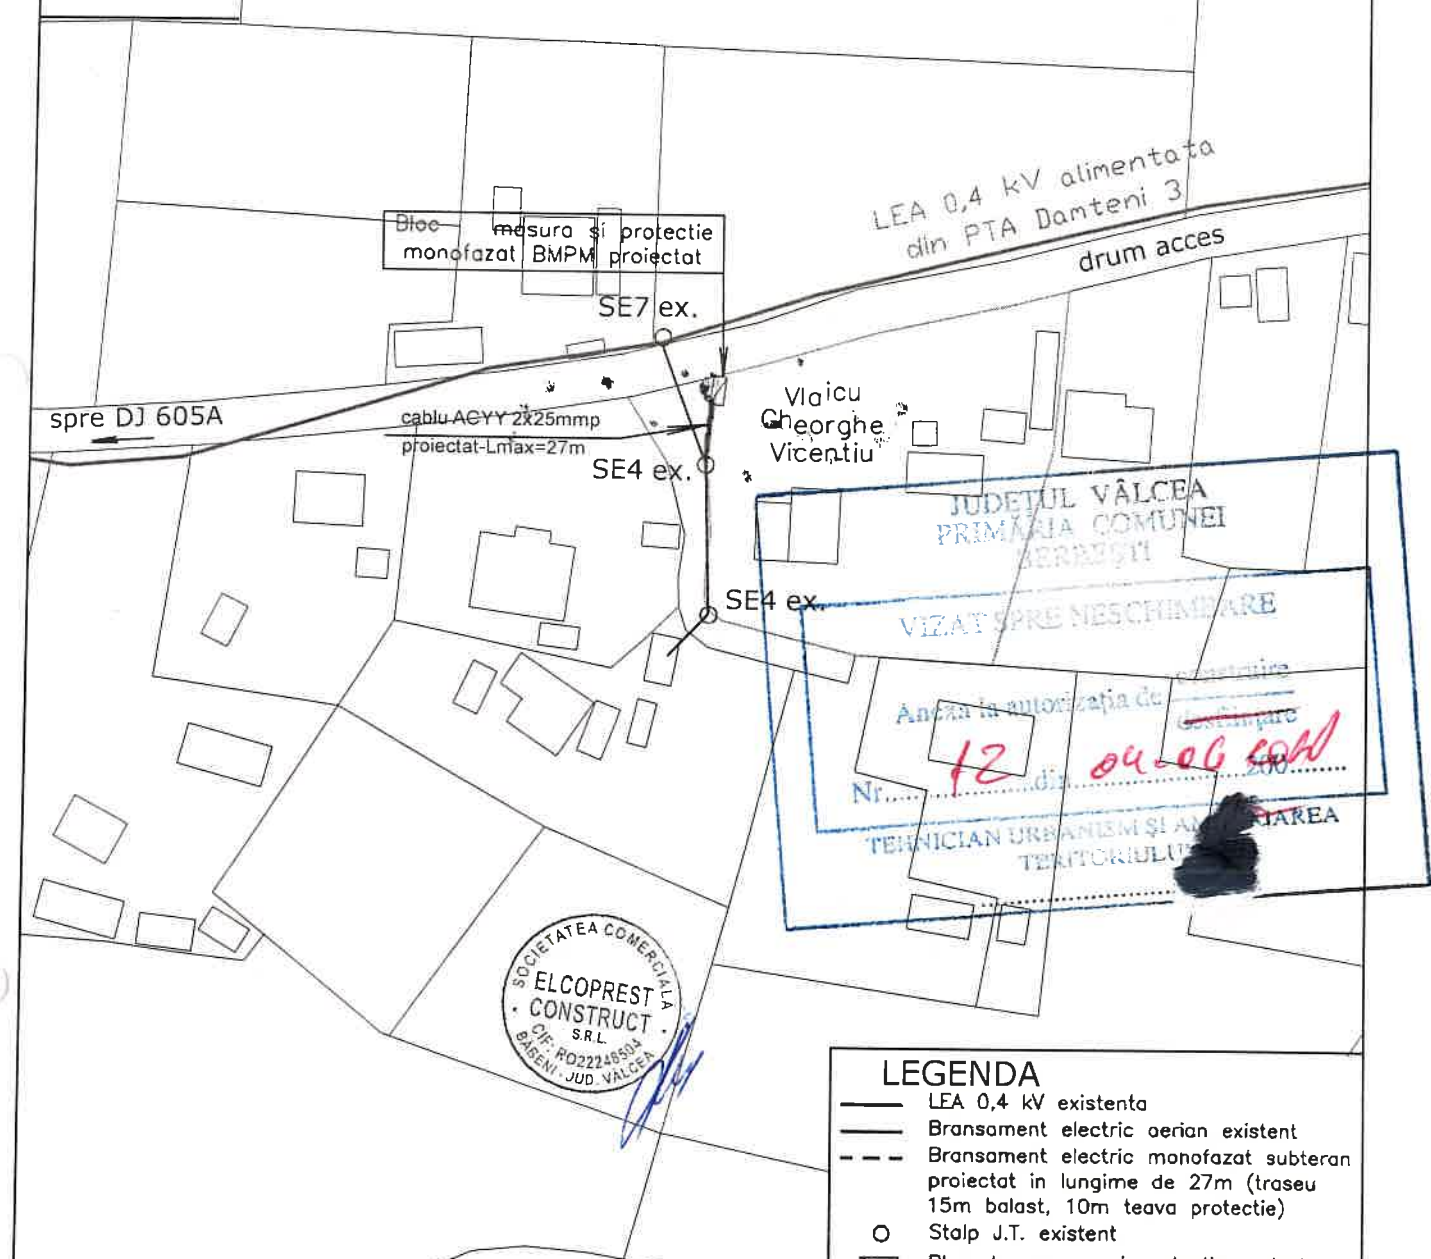

### LEGENDA

- LEA 0,4 kV existenta
- Bransament electric aerian existent
- - - Bransament electric monofazat subteran proiectat in lungime de 27m (traseu 15m balast, 10m teava protectie)
- Stalp J.T. existent
- ▣ Bloc de masura si protectie proiectat

| VERIFICATOR/               | NUME                 | SEMNAURA | CERINTA           | ATESTAT   | REFERAT NR.     |
|----------------------------|----------------------|----------|-------------------|---|-----------------|
| SC ELCOPREST CONSTRUCT SRL |                      |          |                   | Beneficiar:<br>SC DISTRIBUTIE ENERGIE OLTENIA SA - Valcea                     | Proiect nr.     |
| SPECIFICATIE               | NUME                 | SEMNAURA | Scara:<br>1:1000  | Lucrarea:<br>BRANSAMENT ELECTRIC MONOFAZAT SUBTERAN,<br>LOCUINTA - [REDACTED] | Faza:<br>A.C.   |
| SEF PROIECT                | Ing. IOVAN Laurentiu |          |                   |   |                 |
| PROIECTAT                  | Ing. IOVAN Laurentiu |          | Data:<br>Mai 2021 | Denumire planșă:<br>Plan de situatie proiectat                                | Plansa nr.<br>2 |
| DESENAT                    | Ing. IOVAN Laurentiu |          |                   |   |                 |